


OLIVE

USER MANUAL




1. The luminaire shall be installed by a qualified electrician and wired in accordance with the latest IEE electrical regulations or the national requirements.
2. No supplied water-proof box, installation should be advised by qualified professional.
3. The external flexible cable can not be replaced. If the cable is damaged, the luminaire should be discarded.

Electrical schematic

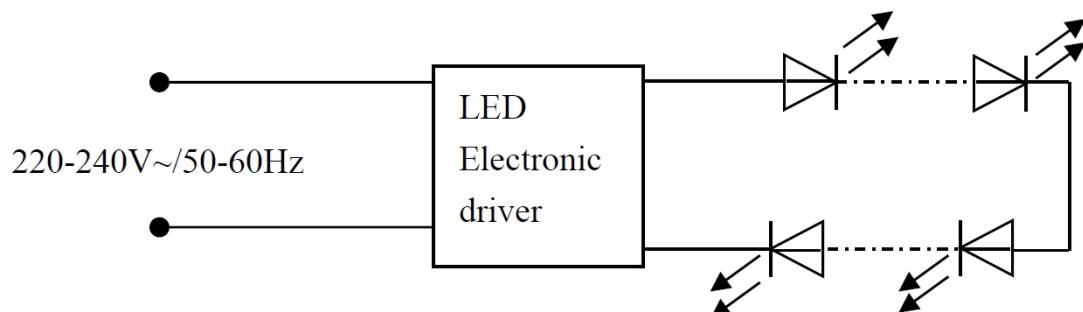

Product dimensions

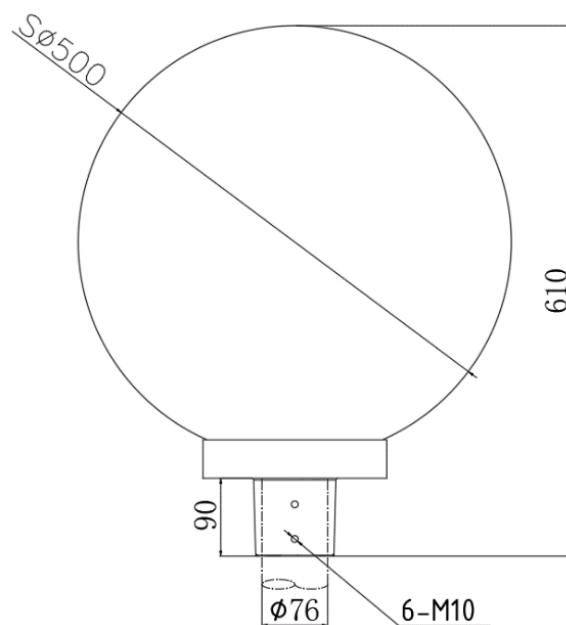

The max projected area: 0.21 m²

The max mounting height: 18 m

Weight: 5.8 Kg

Mounting instruction

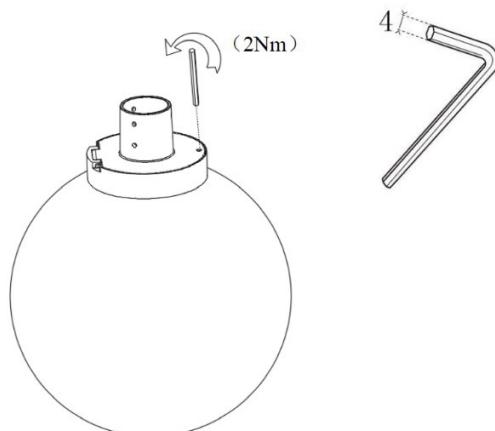


Fig. 1 Loose the screw (1 * M5)

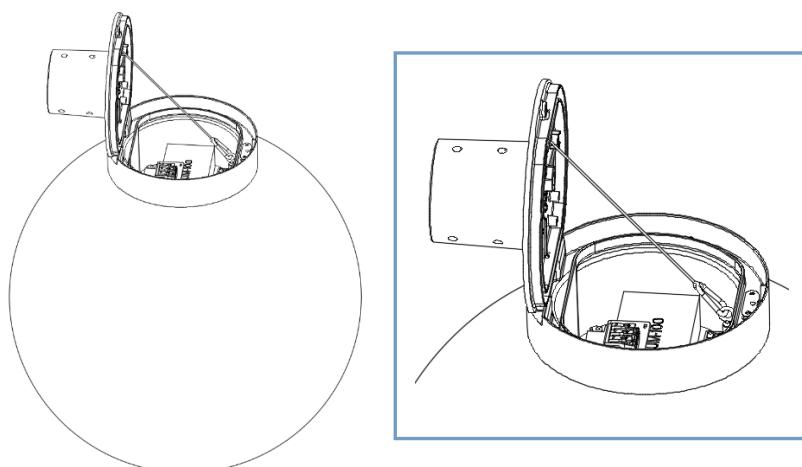


Fig. 2 Hang the hook


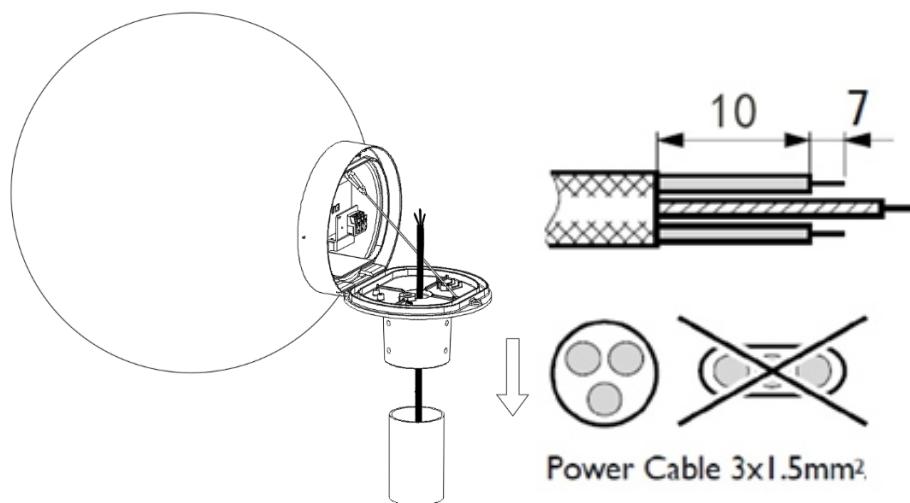


Fig. 3 Fix to the pole (outside diameter: 48 mm -76 mm)

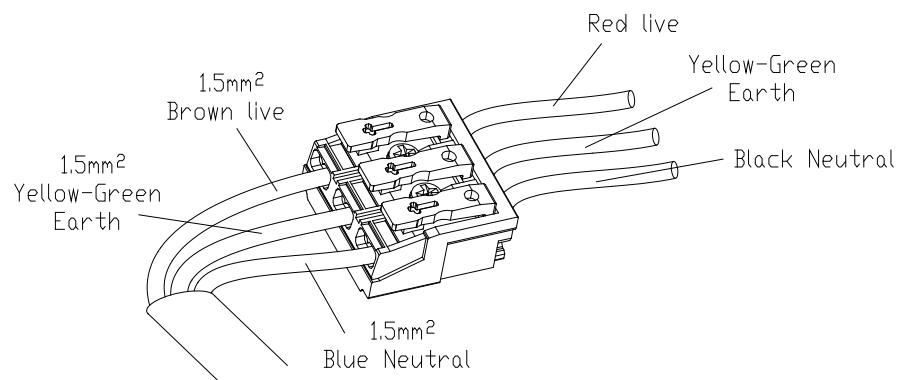

Attention: The input cable should meet the requirement of 60245 IEC 57.

Fig. 4 connect the wire

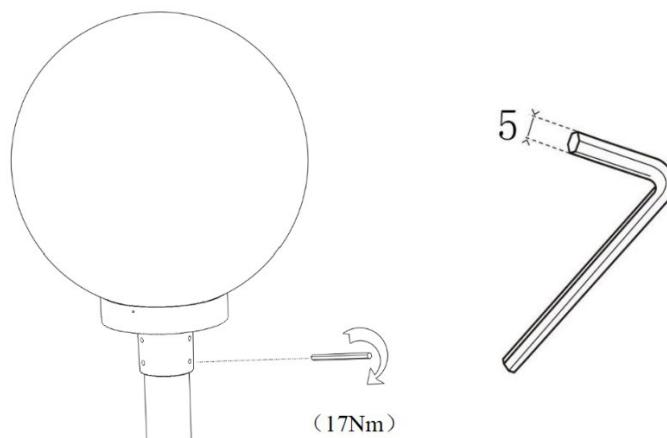


Fig. 5 Close screws (6 * M10)

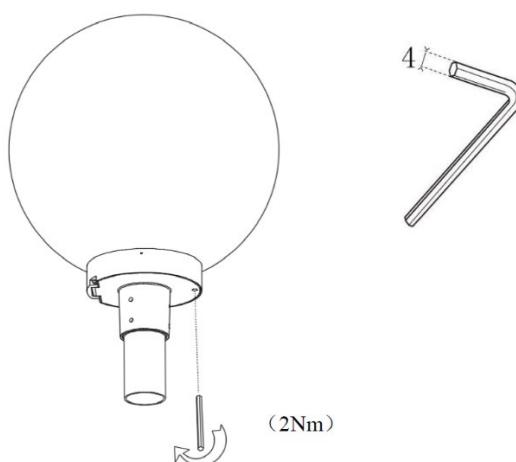


Fig. 6 Close the screw (1 * M5)



1. The lighting should be placed where is cool, dry, clean and not allowed to be placed in the water or closed to fire resource and high temperature place.
2. To make sure the lighting is intact before it is installed and used. Only the authorized electrician can install the lighting, and the wire should be in line with national standards.
3. To lock the wire's fixed head and the screw on the top cover tightly in order to make sure the light is waterproof.
4. Don't switch on the power when connecting the wire.
5. The input cable should be 3 cores for class I luminaire or 2 cores for class II luminaire and the min cross-sectional area of the conductor should be 1.5 mm². The input cable should meet the requirement of 60245 IEC 57.
6. The wiring diagram is only for reference.
7. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.
8. Yearly cleaning service is necessary to prevent from drainage obstruction and over-heating caused by debris, dust, leaves, bird droppings, etc. covered on the luminaires.
9. The luminaire should be positioned so that prolonged staring into the luminaire at a distance closer than 843 mm is not expected.